tyco.

Model BFV-300/BFV-300C **Butterfly Valve Grooved End**

General Description

The TYCO Models BFV-300 and BFV-300C Grooved End Butterfly Valves are indicating type valves designed for use in fire protection systems where a visual indication of open or closed valve condition is required. They are used, for example, as system, sectional and pump water control valves. They have grooved inlet and outlet connections that are suitable for use with grooved end pipe couplings listed or approved for fire protection systems.

For applications requiring supervision of the open or closed state of the valve, the Gear Operators for the Model BFV-300/BFV-300C Butterfly Valves feature two sets of factory installed internal switches each having SPDT contacts, see Figure 3. The supervisory switches transfer their electrical contacts when there is movement from the open or closed disc position during the first two revolutions of the handwheel.

Note: If the butterfly valve is required in a foam system, refer to the foam concentrate manufacturer technical literature for information about foam compatibility and acceptable system equipment materials of construction. to verify the valve is compatible.

NOTICE

The Model BFV-300/BFV-300C Grooved End Butterfly Valves described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION, in addition to the standards of any other authorities having jurisdiction. Failure to do so may impair the performance of these devices

The owner is responsible for maintaining their fire protection system

IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.

Technical Data

Approvals UL and ULC Listed FM Approved CE Certified VdS Approved Russian Fire Certificate CNPP R1 Listed-APSAD Listed by California State Fire Marshall

Refer to Tables A, B and C for applicability.

All laboratory listings and approvals are for indoor and outdoor use.

Sizes 2 in.-12 in. (DN50-DN300)

UL/ULC/FM Maximum Working Pressure

2 in.-8 in. (DN50-DN200) . . . 300 psi (20,7 bar) 10 in. -12 in. (DN250-DN300).175 psi (12,1 bar)

VdS Maximum Working Pressure

Maximum Working Temperature 212°F (100°C) in accordance with UL 1091

Materials of Construction

Body Ductile Iron	
Body Coating RILSAN PA11 Black	
Disc Ductile Iron	
Disc Seal EPDM Encapsulated	
Upper & Lower Stem Stainless Steel	
Handwheel Ductile Iron	
BFV-300 red painted; BFV-300C black painted)	
Actuator, 2 in6 in. (DN50-DN150):	

IP 65, bronze traveling nut gearbox, ductile iron housing

Actuator, 8 in. - 12 in. (DN200-DN300):

IP 65, brass segmented gearbox, ductile iron housing

Silicone Free Model Availability

Silicone free models are available. Contact TYCO sales for information.

Tapping Bosses

Two factory-plugged NPT threaded tapping bosses in the valve body are located on the up- and downstream sides of the disc for connection to valve trim. Tapping boss sizes:




MODEL BFV-300 **OPEN SUPERVISORY SWITCHES**




MODEL BFV-300C **CLOSED SUPERVISORY SWITCHES**





Control Valve Seat Leakage Class IEC 60534-4 CLASS VI (Type C) Control Valve Seat Leakage according to ANSI/FCI 70-2-2006 (ASME B16.104)

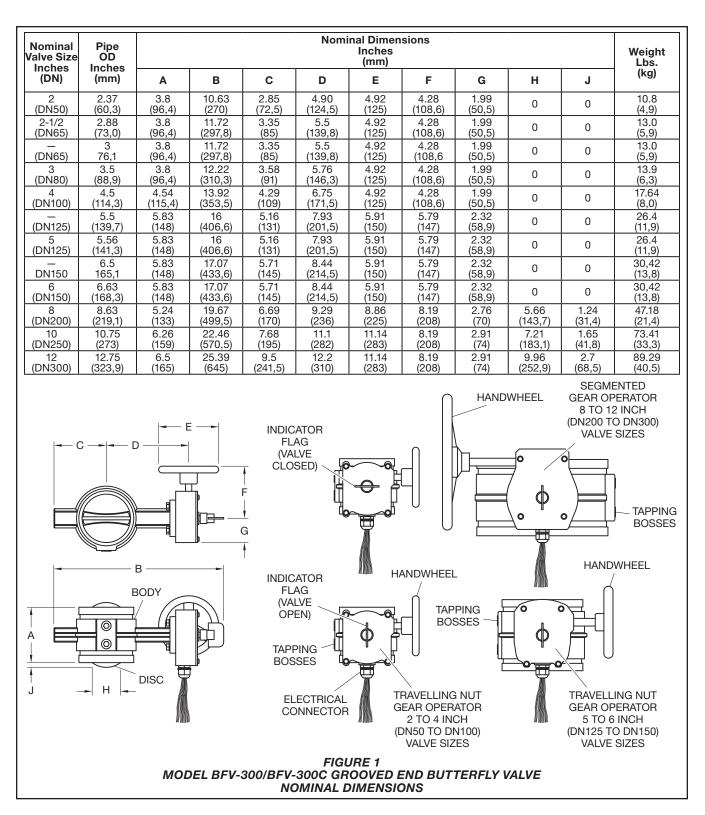

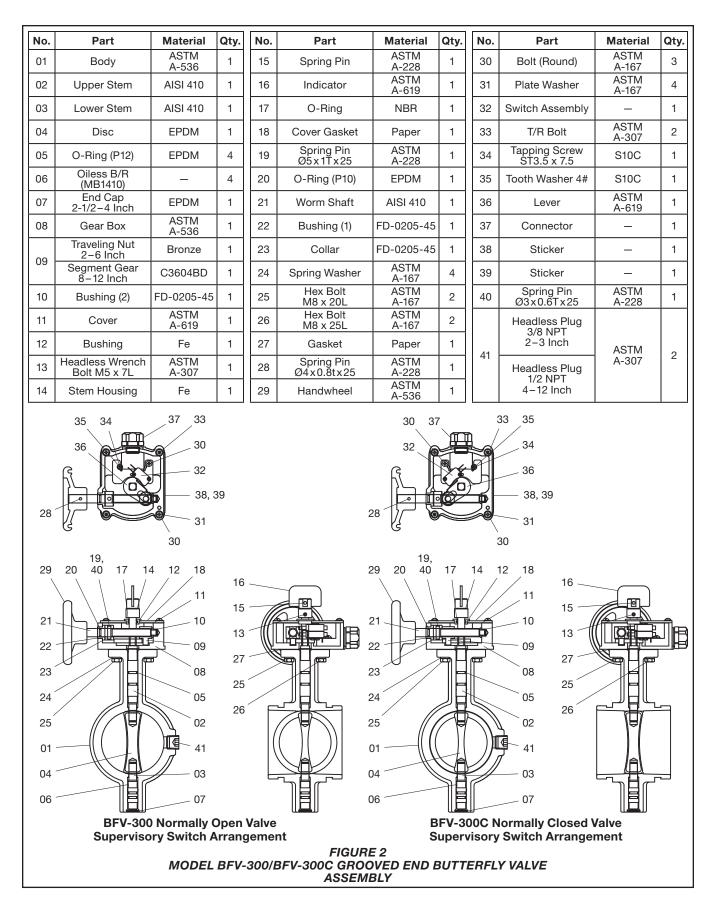

TFP1511 Page 4 of 8

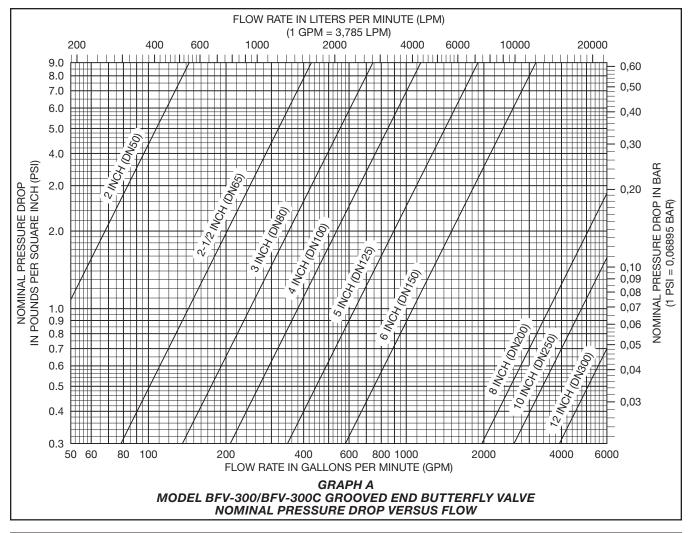

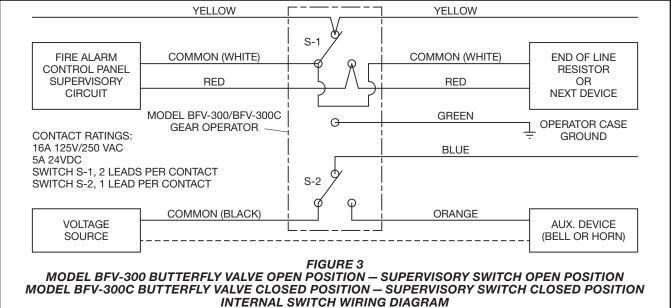

Nominal Pipe Max Part Num				umber	Agency					Listing/Approval				
Valve Size Inches (DN)	O.D. Inches (mm)	Max. PSI (bar)	BFV-300 Supv. Switch OPEN	BFV-300C Supv. Switch CLOSED	CE	UL	ULC	FM	VdS	CA Fire Marshall	CNPP	PAVUS	Russiar Fire Cert.	
2 (DN50)	2.38 (60,3)	300 (20,7)	59300G020WS	59300G020WSC	✓	✓	\checkmark		\checkmark			√	√	
2-1/2 (DN65)	2.88 (73,0)	300 (20,7)	59300G025WS	59300G025WSC	✓	1	✓	\checkmark	\checkmark	\checkmark		\checkmark	\checkmark	
 DN65	3 76,1	300 (20,7)	59300G026WS	59300G026WSC	~	1	✓	\checkmark	\checkmark			\checkmark	\checkmark	
3 (DN80)	3,5 (88,9)	300 (20,7)	59300G030WS	59300G030WSC	~	1	✓	✓	✓	\checkmark		\checkmark	\checkmark	
4 (DN100)	4.5 (114,3)	300 (20,7)	59300G040WS	59300G040WSC	~	1	✓	✓	✓	\checkmark		\checkmark	\checkmark	
 DN125	5.5 (139,7)	300 (20,7)	59300G056WS	59300G056WSC	~	1	✓	✓	✓			\checkmark	\checkmark	
5 (DN125)	5.56 (141,3)	300 (20,7)	59300G050WS	59300G050WSC	✓	1	✓	✓	✓	\checkmark		\checkmark	\checkmark	
 DN150	6.5 (165,1)	300 (20,7)	59300G066WS	59300G066WSC	~	✓	\checkmark	\checkmark	✓			✓	\checkmark	
6 (DN150)	6.63 (168,3)	300 (20,7)	59300G060WS	59300G060WSC	\checkmark	✓	\checkmark	✓	\checkmark	\checkmark		√	√	
8 (DN200)	8.63 (219,1)	300 (20,7)	59300G080WS	59300G080WSC	\checkmark	✓	✓	✓	\checkmark	\checkmark		√	√	
10 (DN250)	10.75 (273)	175 (12,1)	59300G100WS	59300G100WSC	\checkmark	✓	\checkmark	\checkmark	\checkmark	√		√	1	
12 (DN300)	12.75 323,9	175 (12,1)	59300G120WS	59300G120WSC	~	~	✓		~			~	~	

TABLE A MODEL BFV-300/BFV-300C GROOVED END BUTTERFLY VALVE WITH INTERNAL SUPERVISORY SWITCHES PART NUMBER SELECTION AND AGENCY LISTINGS/APPROVALS

Nominal	Pipe	Max.	Part N	lumber	Agency	Listing//	Approval
Valve Size Inches (DN)	O.D. Inches (mm)	PSI (bar)	BFV-300 Supv. Switch OPEN	BFV-300C Supv. Switch CLOSED	CE	VdS	CNPP
2 (DN50)	2.38 (60,3)	300 (20,7)	59300G020AWS	59300G020AWSC	√	\checkmark	✓
2-1/2 (DN65)	2.88 (73,0)	300 (20,7)	59300G025AWS	59300G025AWSC	\checkmark	\checkmark	√
 DN65	3 76,1	300 (20,7)	59300G026AWS	59300G026AWSC	\checkmark	\checkmark	√
3 (DN80)	3,5 (88,9)	300 (20,7)	59300G030AWS	59300G030AWSC	\checkmark	\checkmark	√
4 (DN100)	4.5 (114,3)	300 (20,7)	59300G040AWS	59300G040AWSC	\checkmark	\checkmark	√
 DN125	5.5 (139,7)	300 (20,7)	59300G056AWS	59300G056AWSC	\checkmark	\checkmark	√
5 (DN125)	5.56 (141,3)	300 (20,7)	59300G050AWS	59300G050AWSC	\checkmark	\checkmark	√
 DN150	6.5 (165,1)	300 (20,7)	59300G066AWS	59300G066AWSC	\checkmark	\checkmark	√
6 (DN150)	6.63 (168,3)	300 (20,7)	59300G060AWS	59300G060AWSC	\checkmark	\checkmark	√
8 (DN200)	8.63 (219,1)	300 (20,7)	59300G080AWS	59300G080AWSC	\checkmark	\checkmark	✓
10 (DN250)	10.75 (273)	175 (12,1)	59300G100AWS	59300G100AWSC	\checkmark	\checkmark	✓
12 (DN300)	12.75 323,9	175 (12,1)	59300G120AWS	59300G120AWSC	\checkmark	\checkmark	✓
	DDEL BI		TAE	SLE B			


PART NUMBER SELECTION AND AGENCY LISTINGS/APPROVALS

Nominal	Pipe			Agency Listing/Approval									
/alve Size Inches (DN)		Max. PSI (bar)	Part Number	CE	UL	ULC	FM	VdS	CA Fire Marshall	CNPP	PAVUS	Russian Fire Cert.	
2 (DN50)	2.38 (60,3)	300 (20,7)	59300G020NS	✓	✓	\checkmark		\checkmark			\checkmark	\checkmark	
2-1/2 (DN65)	2.88 (73,0)	300 (20,7)	59300G025NS	✓	✓	\checkmark	\checkmark	\checkmark	\checkmark		\checkmark	\checkmark	
_ DN65	3 76,1	300 (20,7)	59300G026NS	\checkmark	\checkmark	\checkmark	\checkmark	\checkmark			\checkmark	\checkmark	
3 (DN80)	3,5 (88,9)	300 (20,7)	59300G030NS	✓	✓	\checkmark	\checkmark	\checkmark	\checkmark		\checkmark	\checkmark	
4 (DN100)	4.5 (114,3)	300 (20,7)	59300G040NS	✓	✓	\checkmark	\checkmark	\checkmark	\checkmark		\checkmark	\checkmark	
 DN125	5.5 (139,7)	300 (20,7)	59300G056NS	~	\checkmark	\checkmark	\checkmark	\checkmark			\checkmark	\checkmark	
5 (DN125)	5.56 (141,3)	300 (20,7)	59300G050NS	✓	1	\checkmark	\checkmark	\checkmark	\checkmark		\checkmark	\checkmark	
 DN150	6.5 (165,1)	300 (20,7)	59300G066NS	~	✓	\checkmark	\checkmark	✓			✓	\checkmark	
6 (DN150)	6.63 (168,3)	300 (20,7)	59300G060NS	\checkmark	✓	\checkmark	\checkmark	✓	✓		√	\checkmark	
8 (DN200)	8.63 (219,1)	300 (20,7)	59300G080NS	\checkmark	✓	\checkmark	\checkmark	✓	✓		√	\checkmark	
10 (DN250)	10.75 (273)	175 (12,1)	59300G100NS	\checkmark	✓	\checkmark	\checkmark	✓	✓		√	\checkmark	
12 (DN300)	12.75 323,9	175 (12,1)	59300G120NS	~	~	~		✓			~	\checkmark	

TABLE C MODEL BFV-300 GROOVED END BUTTERFLY VALVE WITHOUT INTERNAL SUPERVISORY SWITCHES PART NUMBER SELECTION AND AGENCY LISTINGS/APPROVALS

			Part Number								
Nominal Valve Size Inches (DN)	Gear Operator Type	Mounting Bracket with Mounting Bolts	Bernstein i88-IP65 Regular Switch	Bernstein i88-IP65 LED Switch 24V	Bernstein GC-SU1Z Ex IP-66/67 ATEX (Ex II2G Ex dIIC T6 Gb) Switch						
2-4 (DN50-DN100)	Travelling	59300SPBRACKET10									
5-6 (DN125-DN200)	Nut	59300SPBRACKET20	59300SPSW	59300SPSWLED	59300SPSWATEX						
8 (DN200)	Segmented	59300SPBRACKET25	59300SP3W	59300SP3WLED	59300SPSWATEX						
10-12 (DN250-DN300)	Gear	59300SPBRACKET30									

Notes: 1. Install a single switch in either bracket mounting position to monitor Open or Closed valve condition

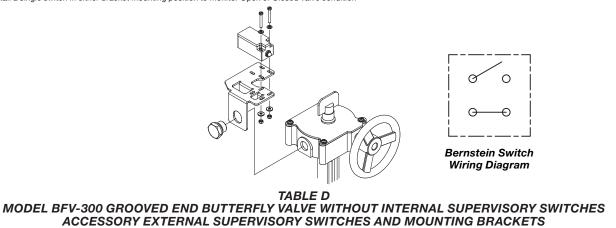

PART NUMBER SELECTION

Installation

The Model BFV-300/BFV-300C Grooved End Butterfly Valves may be installed with flow in either direction and can be positioned either horizontally or vertically.

The grooved end pipe couplings used with the Model BFV-300/BFV-300C must be listed or approved for fire protection service and installed in accordance with the manufacturers instructions.

The Model BFV-300/BFV-300C Butterfly Valve may be installed with any schedule of pressure class of pipe or tubing that is listed or approved for fire protection.

Conduit and electrical connections are to be made in accordance with the authority having jurisdiction and/ or the National Electrical Code. With reference to Figure 3, the supervisory switch is intended for connection to the supervisory circuit of a fire alarm control panel in accordance with NFPA 72. The auxiliary switch is intended for the unsupervised connection to auxiliary equipment in accordance with NFPA 70, National Electric Code.

NOTE: For outdoor applications with internal supervisory switches, it is recommended that wiring connections be made at a temperature above 15°F (-9°C), in order to insure sufficient flexibility of the wire lead insulation.

Care and Maintenance

Before closing a fire protection system control valve for maintenance or inspection work on either the valve or fire protection system which it controls, permission to shut down the affected fire protection systems must be obtained from the proper authorities and all personnel who may be affected by this decision must be notified.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in accordance with the applicable standards of the NATIONAL FIRE PRO-TECTION ASSOCIATION, for example, NFPA 25, in addition to the standards of any authority having jurisdiction. Contact the installing contractor or product manufacturer with any questions. Any impairment must be immediately corrected.

It is recommended that automatic sprinkler systems be inspected, tested, and maintained by a qualified inspection service.

Nominal Valve Size	Part Number						
Inches (DN)	BFV-300, Red Painted	BFV-300C, Black Painted					
2-4 (DN50-DN100)	59300SPHWHEEL10	59300SPHWHEEL10B					
5-8 (DN125-DN200)	59300SPHWHEEL20	59300SPHWHEEL20B					
10-12 (DN250-DN300)	59300SPHWHEEL30	59300SPHWHEEL30B					

TABLE E BFV-300/BFV-300C GROOVED END BUTTERFLY VALVE REPLACEMENT HANDWHEEL PART NUMBER SELECTION

Accessories

External Supervisory Switch and Mounting Bracket

Note: Accessory external supervisory switches and mounting brackets are applicable only to valves without factory-installed internal supervisory switches.

Refer to Table D for switch models and part numbers.

Specify: (specify size) Model BFV-300 Grooved End Butterfly Valve External Switch Mounting Bracket, P/N (specify), with (specify quantity) Bernstein External Switch (specify model), P/N (specify)

Replacement Parts

Note: Only items described in this section are offered as replacement parts.

Handwheel

Replacement handwheel includes pin. Refer to Table E for part numbers.

Model BFV-300, Red Painted

Specify: Handwheel, (specify size) Model BFV-300 Grooved End Butterfly Valve, P/N (specify)

Model BFV-300C, Black Painted

Specify: Handwheel, (specify size) Model BFV-300C Grooved End Butterfly Valve, P/N (specify)

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

Butterfly Valves

Model BFV-300 with Internal Open Supervisory Switches Specify: (specify size) Model BFV-300 Grooved End Butterfly Valve, Internal Open Supervisory Switches, P/N (specify per Table A)

Model BFV-300C with Internal Closed Supervisory Switches Specify: (specify size) Model BFV-300C Grooved End Butterfly Valve, Internal Closed Supervisory Switches, P/N (specify per Table A)

Model BFV-300 with Internal Open Supervisory Switches, APSAD Approved

Specify: (specify size) Model BFV-300 Grooved End Butterfly Valve, Internal Open Supervisory Switches, APSAD Approved, P/N (specify per Table B)

Model BFV-300C with Internal Closed Supervisory Switches, APSAD Approved

Specify: (specify size) Model BFV-300C Grooved End Butterfly Valve, Internal Closed Supervisory Switches, APSAD Approved, P/N (specify per Table B)

Model BFV-300 without Internal Supervisory Switches

Specify: (specify size) Model BFV-300 Grooved End Butterfly Valve, P/N (specify per Table C) **TFP1511** Page 8 of 8

1400 Pennbrook Parkway, Lansdale, PA 19446 | Telephone +1-215-362-0700

© 2019 Johnson Controls. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.

